

**Vattenrörspannor med hjälpinstallationer –**  
Del 11: Krav på utrustning för vakter och  
säkerhetssystem för pannor och tillbehör

**Water-tube boilers and auxilliary installations –**  
Part 11: Requirements for limiting devices of the  
boiler and accessories

This preview is downloaded from [www.sis.se](http://www.sis.se). Buy the entire standard via <https://www.sis.se/std-61538>

ICS 27.060.30; 27.100

Språk: engelska

Publicerad: september 2007

© Copyright SIS. Reproduction in any form without permission is prohibited.

Europastandarden EN 12952-11:2007 gäller som svensk standard. Detta dokument innehåller den officiella engelska versionen av EN 12952-11:2007.

The European Standard EN 12952-11:2007 has the status of a Swedish Standard. This document contains the official English version of EN 12952-11:2007.

---

Uppllysningar om **sakinnehållet** i standarden lämnas av SIS, Swedish Standards Institute, telefon 08 - 555 520 00.

Standarder kan beställas hos SIS Förlag AB som även lämnar **allmänna upplysningar** om svensk och utländsk standard.

*Postadress:* SIS Förlag AB, 118 80 STOCKHOLM  
*Telefon:* 08 - 555 523 10. *Telefax:* 08 - 555 523 11  
*E-post:* [sis.sales@sis.se](mailto:sis.sales@sis.se). *Internet:* [www.sis.se](http://www.sis.se)

EUROPEAN STANDARD

**EN 12952-11**

NORME EUROPÉENNE

EUROPÄISCHE NORM

July 2007

---

ICS 27.040

English Version

## Water-tube boilers and auxiliary installations - Part 11: Requirements for limiting devices of the boiler and accessories

Chaudières à tubes d'eau et installations auxiliaires - Partie  
11: Exigences pour les dispositifs de limitation de la  
chaudière et de ses accessoires

Wasserrohrkessel und Anlagekomponenten - Teil 11:  
Anforderungen an Begrenzungseinrichtungen an Kessel  
und Zubehör

This European Standard was approved by CEN on 26 May 2007.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION  
COMITÉ EUROPÉEN DE NORMALISATION  
EUROPÄISCHES KOMITEE FÜR NORMUNG

**Management Centre: rue de Stassart, 36 B-1050 Brussels**

---

<b>Contents</b>	<b>Page</b>
Foreword.....	3
Introduction .....	4
<b>1 Scope .....</b>	<b>5</b>
<b>2 Normative references .....</b>	<b>5</b>
<b>3 Terms and definitions .....</b>	<b>6</b>
<b>4 Requirements for limiters .....</b>	<b>8</b>
4.1 General.....	8
4.2 Materials and design .....	8
4.3 Electrical equipment.....	9
4.4 Fault assessment.....	9
4.5 Marking .....	11
<b>5 Special requirements for water level limiters .....</b>	<b>13</b>
5.1 Components.....	13
5.2 Design .....	13
5.3 Floating devices.....	14
5.4 Level electrode devices .....	14
5.5 Examination of functional capability .....	15
5.6 Fault detection .....	18
<b>6 Special requirements for pressure limiters .....</b>	<b>18</b>
6.1 Components.....	18
6.2 Additional fault assessment requirements .....	18
6.3 Design .....	18
6.4 Electrical equipment.....	19
6.5 Examination of functional capability .....	19
6.6 Fault detection .....	21
<b>7 Special requirements for temperature limiters.....</b>	<b>21</b>
7.1 Components .....	21
7.2 Design .....	21
7.3 Electrical equipment.....	23
7.4 Examination of functional capability .....	23
<b>8 Special requirements for flow limiters.....</b>	<b>24</b>
8.1 Components .....	24
8.2 Design .....	24
8.3 Electrical equipment.....	24
8.4 Examination of functional capability .....	24
<b>Annex A (informative) Limiting device .....</b>	<b>25</b>
<b>Annex B (informative) Example of an examination plan .....</b>	<b>26</b>
<b>Annex C (informative) Marking of limiters .....</b>	<b>28</b>
<b>Annex D (normative) Immunity against electrical and electromagnetic influences — Requirements and testing.....</b>	<b>31</b>
<b>Annex ZA (informative) Relationship between this European Standard and the Essential Requirements of EU Directive 97/23/EC .....</b>	<b>35</b>
<b>Bibliography .....</b>	<b>36</b>

## Foreword

This document (EN 12952-11:2007) has been prepared by Technical Committee CEN/TC 269 "Shell and water-tube boilers", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by January 2008, and conflicting national standards shall be withdrawn at the latest by January 2008.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this document.

The European Standard EN 12952 concerning water-tube boilers and auxiliary installations consists of the following Parts:

- *Part 1: General.*
- *Part 2: Materials for pressure parts of boilers and accessories.*
- *Part 3: Design and calculation for pressure parts.*
- *Part 4: In-service boiler life expectancy calculations.*
- *Part 5: Workmanship and construction of pressure parts of the boiler.*
- *Part 6: Inspection during construction, documentation and marking of pressure parts of the boiler.*
- *Part 7: Requirements for equipment for the boiler.*
- *Part 8: Requirements for firing systems for liquid and gaseous fuels for the boiler.*
- *Part 9: Requirements for firing systems for pulverized solid fuels for the boiler.*
- *Part 10: Requirements for safeguards against excessive pressure.*
- *Part 11: Requirements for limiting devices of the boiler and accessories.*
- *Part 12: Requirements for boiler feedwater and boiler water quality.*
- *Part 13: Requirements for flue gas cleaning systems.*
- *Part 14: Requirements for flue gas DENOX-systems using liquefied pressurized ammonia and ammonia water solution.*
- *Part 15: Acceptance tests.*
- *Part 16: Requirements for grate and fluidized bed firing systems for solid fuels for the boiler.*

*CR 12952 Part 17: Guideline for the involvement of an inspection body independent of the manufacturer.*

Although these Parts can be obtained separately, it should be recognised that the Parts are inter-dependent. As such, the design and manufacture of water-tube boilers requires the application of more than one Part in order for the requirements of the standard to be satisfactorily fulfilled.

NOTE Parts 4 and 15 are not applicable during the design, construction and installation stages.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

## **EN 12952-11:2007 (E)**

### **Introduction**

The types of limiters which shall be fitted to boilers are specified in EN 12952-7 and the design of the safety systems are specified in EN 50156-1.

A limiter (or limiting device) is one element of a water-tube boiler safety system. It comprises a sensor and monitoring elements to achieve the desired level of reliability.

In order to provide the necessary safety function, for example, to cut off the heat supply to the boiler in the event of a low water fault, the limiter is connected to other elements in the safety system such as actuators and safety logic circuits.

## 1 Scope

This European Standard specifies requirements for limiters (or limiting devices) which are incorporated into safety systems for water-tube boilers as defined in EN 12952-1.

A limiter (or limiting device) can be either:

- a safety accessory as defined in the Pressure Equipment Directive, Article 1, clause 2.1.3, and needs to include the safety logic and final actuator, or
- one element of a safety system, for example, a self-monitoring water level sensor used as part of a safety accessory as defined in the Pressure Equipment Directive, Article 1, clause 2.1.3. The overall boiler protection function shall be provided in association with additional safety logic (where appropriate) and a final actuator.

The design requirements and examination of functional capability for the limiters are covered in this European Standard.

For an explanation of the extent of the limiter (or limiting device) see Figure A.1.

## 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 298:2003, *Automatic gas burner control systems for gas burners and gas burning appliances with or without fans*

EN 50156-1:2004, *Electrical equipment for furnaces and ancillary equipment — Part 1: Requirements for application design and installation*

EN 60529:1991, *Degrees of protection provided by enclosures (IP code) (IEC 60529:1989)*

EN 60730-1:2000, *Automatic electrical controls for household and similar use — Part 1: General requirements (IEC 60730-1:1999, modified)*

EN 61000-4-2:1995, *Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 2: Electrostatic discharge immunity test — Basic EMC publication (IEC 61000-4-2:1995)*

EN 61000-4-3:2006, *Electromagnetic compatibility (EMC) — Part 4-3: Testing and measurement techniques — Radiated, radio-frequency, electromagnetic field immunity test (IEC 61000-4-3:2006)*

EN 61000-4-4:2004, *Electromagnetic compatibility (EMC) — Part 4-4: Testing and measurement techniques — Electrical fast transient/burst immunity test (IEC 61000-4-4:2004)*

EN 61000-4-5:2006, *Electromagnetic compatibility (EMC) — Part 4-5: Testing and measurement techniques — Surge immunity test (IEC 61000-4-5:2005)*

EN 61000-4-6:1996, *Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 6: Immunity to conducted disturbances, induced by radio-frequency fields (IEC 61000-4-6:1996)*

EN 61000-4-8:1993, *Electromagnetic compatibility (EMC) — Part 4: Testing and measurement techniques — Section 8: Power frequency magnetic field immunity test; basic EMC publication (IEC 61000-4-8:1993)*

## EN 12952-11:2007 (E)

EN 61000-4-11:2004, *Electromagnetic compatibility (EMC) — Part 4-11: Testing and measurement techniques — Voltage dips, short interruptions and voltage variations immunity tests (IEC 61000-4-11:2004)*

EN 61000-6-2:2005, *Electromagnetic compatibility (EMC) — Part 6-2: Generic standards — Immunity for industrial environments (IEC 61000-6-2:2005)*

EN 61508-3:2001, *Functional safety of electrical/electronic/programmable electronic safety-related systems — Part 3: Software requirements (IEC 61508-3:1998 + Corrigendum 1999)*

### 3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

#### 3.1 limiter

limiting device that, on reaching a fixed value (e.g. pressure, temperature, flow, water level) is used to interrupt and lock-out the energy supply

NOTE Limiting device comprises:

- a measuring or detection function and
- an activation function for correction, or shutdown, or shutdown and lockout, and which is used to carry out safety related functions as defined in the PED, as on its own or as part of safety (protective) system (e.g. sensors, limiters) (see also Figure 3.1). If this is achieved by multi channel systems, then all items or limiters for safety purposes are included within the safety (protective) system.

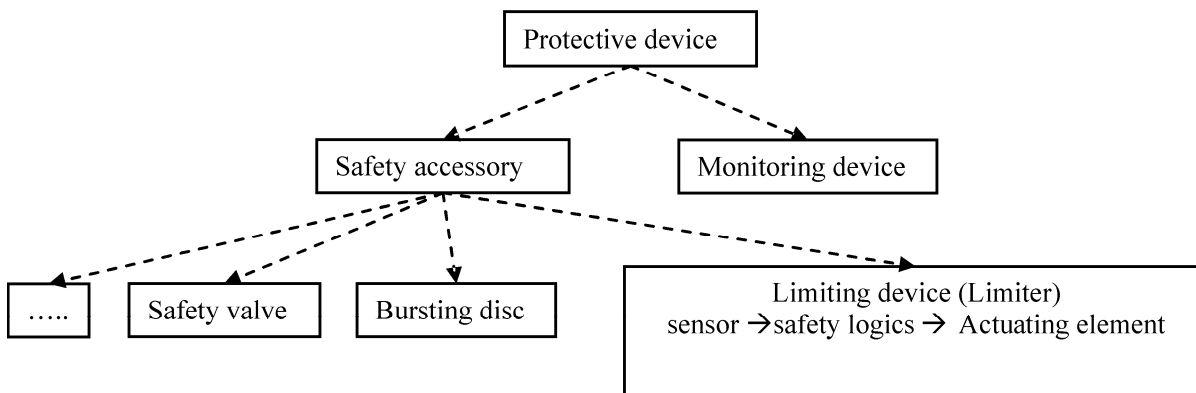


Figure 1 — Protective devices and safety accessories according to Directive 97/23/EC (PED)

#### 3.2 actuating element

component which produces changes in other electrical circuits or volume flows (e.g. fuel, air) as a result of the effect of changes in signal

NOTE For example, a gas shut off valve is not an actuating element.

#### 3.3 fail-safe

limiter is fail-safe if it possesses the capability of remaining in a safe condition or transferring immediately to another safe condition in the event of certain faults occurring

#### 3.4 self-monitoring

regular and automatic determination that all chosen components of a safety system are capable of functioning as required



### 3.5

#### **redundancy**

provision of more than one device or system which, in the event of a fault, will still be provided by the necessary facilities

### 3.6

#### **diversity**

provision of different means of performing the required function, e.g. other physical principles or other ways of solving the same problem

### 3.7

#### **complex electronics**

assemblies which use electronic components with more than one functional output

### 3.8

#### **safety shut-down**

process which is effected immediately following the detection of a fault within the limiter or caused by exceeding the threshold of the process value limit resulting in a defined state with deactivated terminals of the safety output(s)

### 3.9

#### **lock-out**

safety shut-down condition of the limiter, such that a restart can only be accomplished by a manual reset of the limiter or by a manual reset of the safety logic and by no other means. This will be achieved by a competent operator taking account of the physical situation

### 3.10

#### **sensor**

transducer which, on reaching a defined limit value, outputs a signal and/or cuts out and only reverses the output signal in the event of a specific change in the performance quantity (e.g. pressure, temperature, flow, level)

NOTE Sensors are used for signalling or for triggering control processes.

## EN 12952-11:2007 (E)

### 4 Requirements for limiters

#### 4.1 General

**4.1.1** The requirements set out below shall be followed to ensure uniform assessment of different devices.

A limiter shall be such that a single fault in any related part shall not lead to a loss of the safety function. This shall be achieved by fault avoidance techniques such as self-monitoring with redundancy, diversity or a combination of these methods. Fault assessment for the electrical components shall be in accordance with 4.4. The fault assessment chart, see Figure 2 shall also be applied for faults in hydraulic, pneumatic and mechanical components.

NOTE The various elements of limiters are given in Annex A. An example of an examination plan is given in Annex B.

**4.1.2** Limiters shall function independently of each other and of controls unless their safety function cannot be affected by other such functions. Manual resetting can be realised as a part of the limiter or as a part of the safety logic. Instructions shall be delivered together with the limiter including necessary precautions for a safe installation of it.

#### 4.2 Materials and design

**4.2.1** The use of materials with significant differences in their electrochemical potential shall be avoided in order to prevent corrosion which could affect the function of the limiter.

**4.2.2** Care shall be taken that if magnetic materials are chosen, they do not adversely affect the working of the limiter.

**4.2.3** Parts of the limiter shall be designed to comply with the applicable European Standards.

**4.2.4** Limiters shall be capable of withstanding the thermal, mechanical, chemical and electrical loads that can occur during operation.

**4.2.5** Limiters shall be designed such that changes in critical circuit component values (such as those affecting timing) within the component manufacturer's declared worst case tolerances, including the long term stability, shall result in the system continuing to function in accordance with this standard. Compliance shall be checked by worst case analysis.

#### 4.2.6 Limiters using complex electronics

For limiters using complex electronics the following requirements apply additionally:

- General

Systematic errors (built into the design) shall be avoided and random faults (component faults) shall be controlled by techniques such as self-monitoring with redundancy, diversity or a combination of these methods.

- Fault avoidance and fault tolerance

The design of the software and hardware shall be based on the functional analysis of the limiter resulting in a structured design explicitly incorporating the control flow, data flow and time related functions required by the application. In the case of custom-chips special attention is required with regard to measures taken to minimise systematic errors.

Software shall be designed using EN 61508-3 to a SIL level (Safety Integrity Level) as determined by analysis according to EN 50156-1.

### 4.3 Electrical equipment

**4.3.1** All wiring and electrical equipment in connection with the limiter shall be adequately protected against the ingress of moisture and the effect of temperature (see [2], [3]).

**4.3.2** The function of the limiter and the associated electrical circuit responsible for shutting down and locking out the heat supply system shall not be affected by other electrical circuits in their proximity. Screened cables shall be used where necessary (see [2], [3]).

**4.3.3** Electrical components within units directly attached to the boiler shall be capable of withstanding a temperature environment resulting from surrounding temperatures of up to 70 °C. Components within units not directly attached to the boiler shall be capable of withstanding an ambient temperature of up to 55 °C. Any equipment that is in contact with parts carrying steam or hot water shall be capable of withstanding the temperature of those parts.

**4.3.4** Devices shall have, as a minimum, a protection rating to IP 54 in accordance with EN 60529. When units are installed inside an enclosure or control box, the IP rating required for the box shall be considered adequate.

**4.3.5** All mechanical output contacts of the device shall be of the snap action type. Semi-conductor switches shall have similar characteristics.

**4.3.6** The limiter shall tolerate electrical and electromagnetical influences as defined in Annex D.

### 4.4 Fault assessment

#### 4.4.1 General

The limiter, excluding the stored programme section, shall be so constructed that the fault assessment analysis results in termination. Power failure, breaks in connecting cables and short circuits shall also be considered and included in the fault assessment analysis.

#### 4.4.2 Fault models and exclusions

##### 4.4.2.1 General

With fault assessment in accordance with Figure 2, it shall be assumed that certain faults do not occur. Such assumptions are justified by describing the failure mechanism as well as by stating the conditions relating to design, construction, environment etc. for the conductors, components and equipment.

Faults which shall be taken into account are based on in EN 298:2003, Annex A with consideration of the following faults which may be excluded without further justification:

##### 4.4.2.2 Conductor-to-conductor short circuit fault

This fault may be excluded if:

- a) cables and conductors as specified in EN 50156-1 are used;
- b) components are encapsulated so that they are moisture resistant or, if they are hermetically sealed and they are capable of withstanding the test specified in EN 50156-1;
- c) the clearance between live parts shall be designed according to overvoltage category III and pollution degree 3 and the creepage distance shall be designed according to pollution degree 3 but at least for the nominal voltage of 63 V as specified in EN 60664-1;