

# SVENSK STANDARD

## SS-ISO 10295-2:2009

Fastställt/Approved: 2009-02-23

Publicerad/Published: 2009-03-26

Utgåva/Edition: 1

Språk/Language: engelska/English

ICS: 13.220.50; 91.140.01

---

### **Brandteknisk provning av byggnadselement och komponenter – Brandprovning av installationer – Del 2: Tätning av raka fogar (ISO 10295-2:2009, IDT)**

### **Fire tests for building elements and components – Fire testing of service installations – Part 2: Linear joint (gap) seals (ISO 10295-2:2009, IDT)**

This preview is downloaded from [www.sis.se](http://www.sis.se). Buy the entire standard via <https://www.sis.se/std-68950>

# Hitta rätt produkt och ett leveranssätt som passar dig

## Standarder

Genom att följa gällande standard både effektiviserar och säkrar du ditt arbete. Många standarder ingår dessutom ofta i paket.

## Tjänster

Abonnemang är tjänsten där vi uppdaterar dig med aktuella standarder när förändringar sker på dem du valt att abonnera på.

På så sätt är du säker på att du alltid arbetar efter rätt utgåva.

e-nav är vår online-tjänst som ger dig och dina kollegor tillgång till standarder ni valt att abonnera på dygnet runt. Med e-nav kan samma standard användas av flera personer samtidigt.

## Leveranssätt

Du väljer hur du vill ha dina standarder levererade. Vi kan erbjuda dig dem på papper och som pdf.

## Andra produkter

Vi har böcker som underlättar arbetet att följa en standard. Med våra böcker får du ökad förståelse för hur standarder ska följas och vilka fördelar den ger dig i ditt arbete. Vi tar fram många egna publikationer och fungerar även som återförsäljare. Det gör att du hos oss kan hitta över 500 unika titlar. Vi har även tekniska rapporter, specifikationer och "workshop agreement".

Matriser är en översikt på standarder och handböcker som bör läsas tillsammans. De finns på [sis.se](http://sis.se) och ger dig en bra bild över hur olika produkter hör ihop.

## Standardiseringsprojekt

Du kan påverka innehållet i framtida standarder genom att delta i någon av SIS ca 400 Tekniska Kommittéer.

# Find the right product and the type of delivery that suits you

## Standards

By complying with current standards, you can make your work more efficient and ensure reliability. Also, several of the standards are often supplied in packages.

## Services

Subscription is the service that keeps you up to date with current standards when changes occur in the ones you have chosen to subscribe to. This ensures that you are always working with the right edition.

e-nav is our online service that gives you and your colleagues access to the standards you subscribe to 24 hours a day. With e-nav, the same standards can be used by several people at once.

## Type of delivery

You choose how you want your standards delivered. We can supply them both on paper and as PDF files.

## Other products

We have books that facilitate standards compliance. They make it easier to understand how compliance works and how this benefits you in your operation. We produce many publications of our own, and also act as retailers. This means that we have more than 500 unique titles for you to choose from. We also have technical reports, specifications and workshop agreements.

Matrices, listed at [sis.se](http://sis.se), provide an overview of which publications belong together.

## Standardisation project

You can influence the content of future standards by taking part in one or other of SIS's 400 or so Technical Committees.

Den internationella standarden ISO 10295-2:2009 gäller som svensk standard. Detta dokument innehåller den officiella engelska versionen av ISO 10295-2:2009.

The International Standard ISO 10295-2:2009 has the status of a Swedish Standard. This document contains the official English version of ISO 10295-2:2009.

© Copyright/Upphovsrätten till denna produkt tillhör SIS, Swedish Standards Institute, Stockholm, Sverige. Användningen av denna produkt regleras av slutanvändarlicensen som återfinns i denna produkt, se standardens sista sidor.

© Copyright SIS, Swedish Standards Institute, Stockholm, Sweden. All rights reserved. The use of this product is governed by the end-user licence for this product. You will find the licence in the end of this document.

Upplysningar om sakinnehållet i standarden lämnas av SIS, Swedish Standards Institute, telefon 08-555 520 00.

Standarder kan beställas hos SIS Förlag AB som även lämnar allmänna upplysningar om svensk och utländsk standard.

Information about the content of the standard is available from the Swedish Standards Institute (SIS), tel +46 8 555 520 00.

Standards may be ordered from SIS Förlag AB, who can also provide general information about Swedish and foreign standards.

SIS Förlag AB, SE 118 80 Stockholm, Sweden. Tel: +46 8 555 523 10. Fax: +46 8 555 523 11.

E-mail: [sis.sales@sis.se](mailto:sis.sales@sis.se) Internet: [www.sis.se](http://www.sis.se)

**SS-ISO 10295-2:2009 (E)**

<b>Contents</b>		Page
Foreword .....		iv
Introduction.....		v
1	Scope .....	1
2	Normative references.....	1
3	Terms and definitions .....	2
4	Symbols and abbreviated terms .....	3
5	Test equipment.....	3
6	Test conditions .....	4
7	Specimen preparation.....	4
8	Instrumentation .....	9
9	Test procedure.....	10
10	General performance criteria .....	11
11	Expression of test results.....	12
12	Test report.....	12
Annex A (normative) Movement, deflection and other configurations .....		15
Annex B (normative) Field of application.....		17
Annex C (informative) Commentary and guidance .....		20
Bibliography.....		24

## Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 10295-2 was prepared by Technical Committee ISO/TC 92, *Fire safety*, Subcommittee SC 2, *Fire containment*.

ISO 10295 consists of the following parts, under the general title *Fire tests for building elements and components — Fire testing of service installations*:

- *Part 1: Penetration seals*
- *Part 2: Linear joint (gap) seals*

A Part 3 dealing with guidance on the use of a test configuration to establish the direct and extended fields of application for single-component penetration seals is under development.

## SS-ISO 10295-2:2009 (E)

### Introduction

This part of ISO 10295 describes test methods used to determine the fire resistive nature of joint seals when subjected to the standard fire-exposure conditions outlined in ISO 834-1. The test data generated by this International Standard permit the classification of these various joint seals based on their intended use and fire resistance under the specified acceptance criteria of this part of ISO 10295.

Joint seals are positioned in joints, voids, gaps or other discontinuities between or bounded by two or more supporting elements. Normally such openings are denoted as “linear” because the length is greater than the width, defined by a typical ratio of at least 10:1 as in practice. Joints are present in buildings as a result of

- a) design to accommodate various movements induced by thermal differentials, seismic events and wind loads and exist as a clearance separation;
- b) acceptable dimensional tolerances between two or more building elements, e.g. between non-load-bearing walls and floors;
- c) inadequate design, inaccurate assembly, repairs or damage to the building.

This part of ISO 10295 describes methods of test for evaluating joint seals based on their intended use. This part of ISO 10295 also allows for the application of movement prior to and/or during fire testing.

This part of ISO 10295 provides the requirements for the test specimen, the test construction, the equipment (including any special apparatus or instrumentation), the procedures and acceptance criteria as they apply to joint seals and their supporting elements.

# Fire tests for building elements and components — Fire testing of service installations —

## Part 2: Linear joint (gap) seals

**CAUTION** — The attention of all persons concerned with managing and carrying out this fire-resistance test is drawn to the fact that fire testing can be hazardous and that there is a possibility that toxic and/or harmful smoke and gases can be evolved during the test. Mechanical and operational hazards can also arise during the construction of the test elements or structures, their testing and disposal of test residues.

An assessment of all potential hazards and risks to health shall be made and safety precautions shall be identified and provided. Written safety instructions shall be issued. Appropriate training shall be given to relevant personnel. Laboratory personnel shall ensure that they follow written safety instructions at all times.

### 1 Scope

This part of ISO 10295 specifies the heating conditions, methods of test and criteria for the evaluation of the ability of a linear joint seal to maintain the fire integrity and thermal insulation of a fire-separating element at the joint being sealed. The purpose of the tests is to assess the integrity and insulation performance of the linear joint seals, including the effects of induced movement in those cases where the joint is designed to accommodate movement and has a width greater than 20 mm.

It is not the intention of this part of ISO 10295 to provide quantitative information on the rate of leakage of smoke and/or gases, or on the transmission or generation of fumes, although such phenomena can be recorded in describing the general behaviour of specimens during the test. It is not the intention of this part of ISO 10295 to evaluate joint seals where special test procedures already exist, e.g. doors, partitions, penetrations, pipes, ducts and cables.

### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 834-1, *Fire-resistance tests — Elements of building construction — Part 1: General requirements*

ISO 13943, *Fire safety — Vocabulary*

## SS-ISO 10295-2:2009 (E)

### 3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 13943 and the following apply.

#### 3.1

##### **blockout**

recess created in the supporting construction to allow the installation of the joint seal

NOTE It is typically not required on all joint seals.

#### 3.2

##### **fire-separating element**

floor, wall or other separating element of construction having a period of fire resistance determined in accordance with ISO 834-1

#### 3.3

##### **joint**

linear void having a length to width ratio of at least 10:1 between or within two juxtaposed elements

NOTE Typical locations of joints include floors, the perimeter of floors, walls, ceilings and roofs.

#### 3.4

##### **joint seal**

system designed to maintain the fire-separating function and, where required, to accommodate a specified degree of movement

#### 3.5

##### **maximum joint width**

widest opening an installed joint seal is intended to tolerate

NOTE It is stated by the manufacturer or test sponsor.

#### 3.6

##### **minimum joint width**

narrowest opening an installed joint seal is intended to tolerate

NOTE It is stated by the manufacturer or test sponsor.

#### 3.7

##### **nominal joint width**

specified opening of a joint in practice

NOTE It is selected by the manufacturer or test sponsor.

#### 3.8

##### **splice**

connection or junction within the length of a joint seal

#### 3.9

##### **supporting construction**

fire-separating elements into which joint seals are installed

#### 3.10

##### **termination**

special design details applied at the ends of a joint seal

#### 3.11

##### **test construction**

complete assembly of test specimens together with their supporting construction



**3.12****test specimen**

joint seal of specific materials, design and dimensions

**3.13****transition**

change in a direction in a joint seal, e.g. from horizontal to vertical in a wall construction, or through 90° at the perimeter of a floor slab

**4 Symbols and abbreviated terms**

For the purposes of this part of ISO 10295, the symbols and abbreviated terms given in ISO 834-1, together with the following, apply.

**Table 1 — Symbol description**

<b>Symbol</b>	<b>Description</b>
$D_{\text{sup}}$	Supporting element thickness
$f$	Deflection as function of the fire-resistance time
$F_{\text{mov}}$	Movement capability factor
$l_1$	Minimum furnace width
$l_2$	Thickness of supporting construction
$l_3$	Minimum 305 mm
$l_4$	Minimum 610 mm for horizontal supporting construction and 458 mm for vertical supporting construction
$l_5$	Minimum twice the thickness of supporting construction
$W_{\text{MAX}}$	Maximum joint width
$W_{\text{MIN}}$	Minimum joint width
$W_{\text{NOM}}$	Nominal joint width

**5 Test equipment**

**5.1 Test equipment specified in ISO 834-1**, which is applicable to all joint seals tested within the scope of this part of ISO 10295.

**5.2 Test furnace**, with internal dimensions such that a distance of at least 200 mm exists between the side or long edge of a linear joint and the furnace boundary, subject to a minimum internal size of 1 m × 1 m × 1 m for horizontal (floor) furnaces.

For vertical (wall) furnaces, the minimum internal size of the furnace shall be 1 m × 1 m and of sufficient depth to ensure that the temperature conditions specified in ISO 834-1 can be achieved, that the pressure conditions described in 6.2 can be achieved and that the test specimen is not subject to direct flame impingement at any time during the conduct of a test.

**5.3 Apparatus used for cycling of the test specimens prior to the fire test**, capable of continuous and repetitive movement between two specified points that cycles the test specimen between the minimum and maximum joint widths, and be equipped with an automatic counter capable of displaying the number of completed cycles.

## SS-ISO 10295-2:2009 (E)

### 6 Test conditions

#### 6.1 Heating conditions

The heating conditions shall conform to ISO 834-1.

#### 6.2 Pressure

**6.2.1** For vertical test constructions, the furnace shall be operated such that a minimum pressure of 20 Pa exists at the bottom of any test specimen.

**6.2.2** In vertical elements, all splices shall be located within the positive pressure zone so that the pressure at the bottom of the splice is a minimum of 20 Pa for the lowest splice in the test construction.

**6.2.3** For horizontal test constructions, the furnace shall be operated such that a minimum pressure of 20 Pa is established at a position  $(100 \pm 10)$  mm below the lowest point of the test construction.

#### 6.3 Load

Where applicable, a load shall be applied in accordance with the principles of ISO 834-1.

#### 6.4 Movement

Where the seal is greater than 20 mm wide and is designed to accommodate movement, the joint shall be cycled prior to the test in accordance with Annex A using the information required in 7.8.4.


### 7 Specimen preparation

#### 7.1 Supporting construction

The supporting construction shall be of known fire resistance and representative of that used in practice.

#### 7.2 Test construction

**7.2.1** For the purposes of tests, joints can be formed in slabs or by adjacent discrete members; see Figure 1.

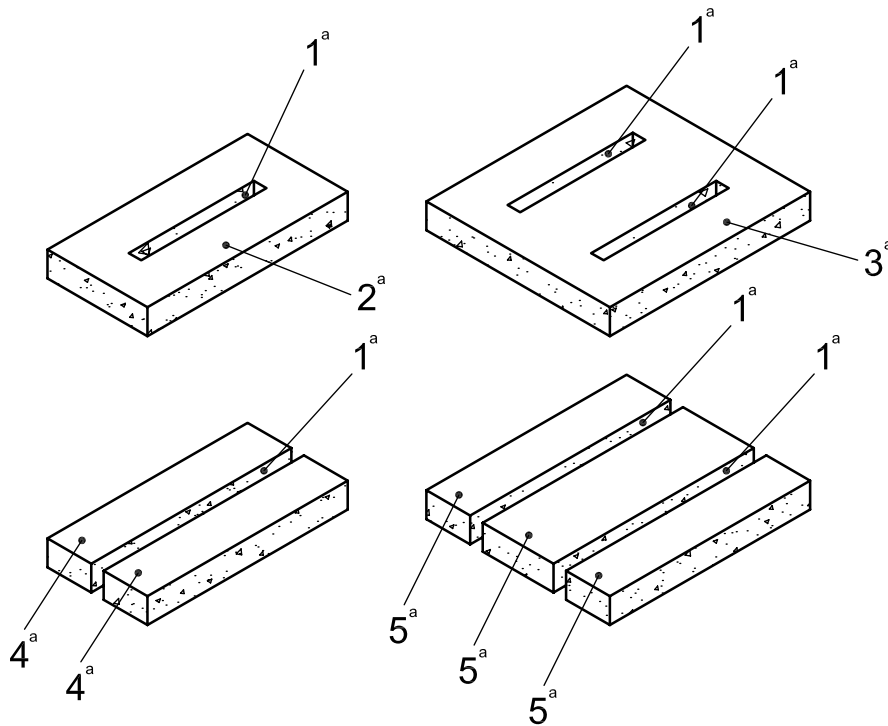


**Key**

- 1 linear joints
- 2 monolithic slab, single joint adjacent
- 3 monolithic slab, multiple joints adjacent
- 4 discrete members, single joint
- 5 discrete members, multiple joints

<sup>a</sup> Supporting constructions made of monolithic slabs may be used only for testing static joints.

**Figure 1 — Supporting construction**

**7.2.2** A test construction may consist of multiple variations in test-specimen widths, joint configurations, test-specimen configurations, joint-face positions and supporting elements of varying thickness, see Figures 2 and 3.

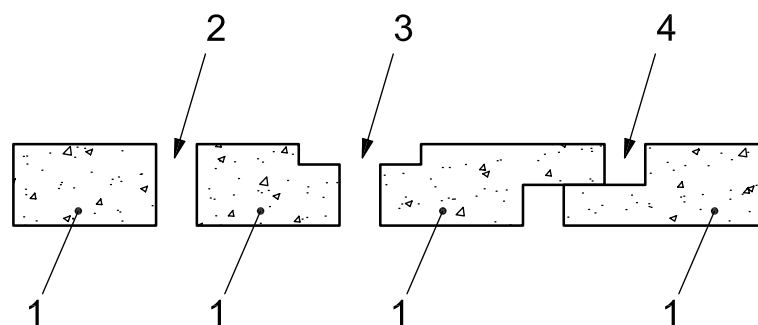

**Key**

- 1 supporting construction
- 2 linear joint (single-stage joint)
- 3 linear joint with blockouts
- 4 linear offset joint (multi-stage joint)

**Figure 2 — Joint configuration**